

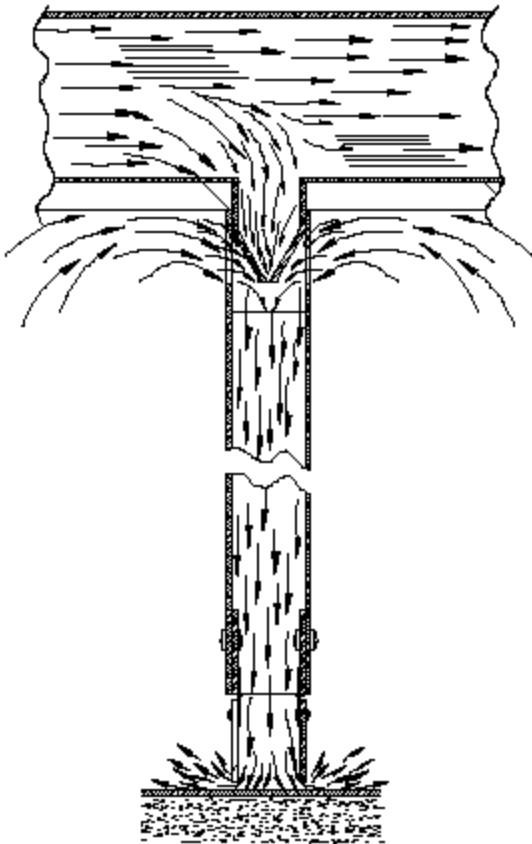


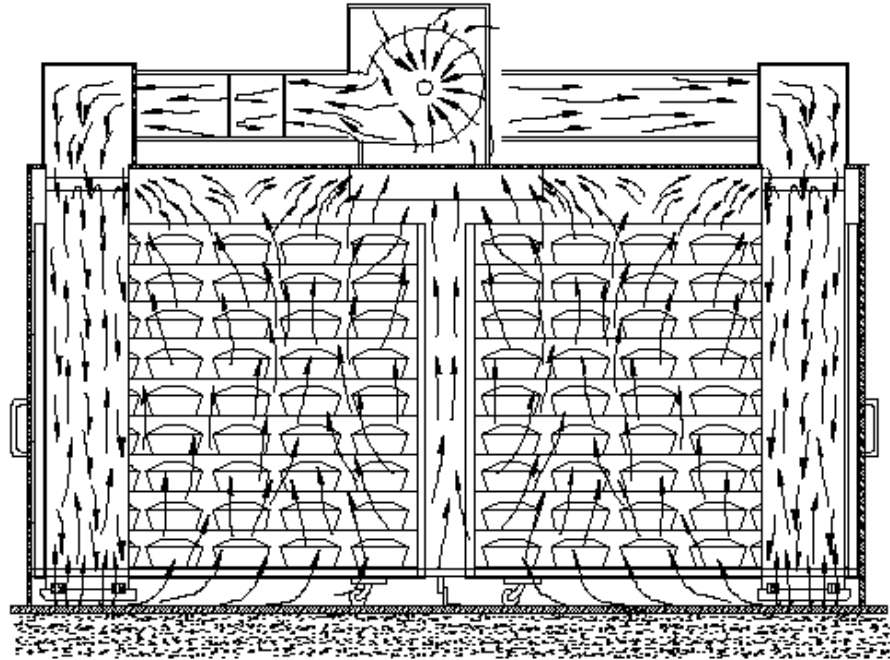

The Fred D. Pfening Company

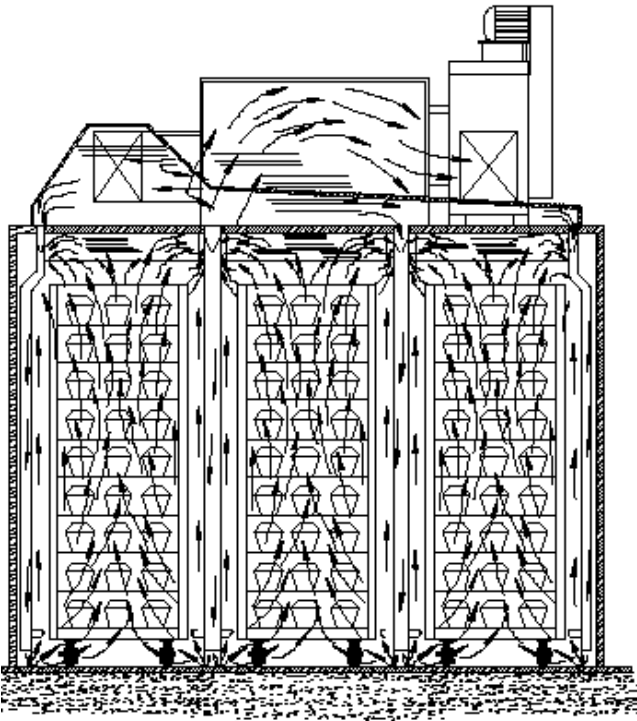

THE GENTLEST WHIRLWIND EVER CREATED

Look carefully at the arrows indicating the conditioned air flow direction throughout the entire box. Take the volume of air coming out of the downspout at the floor line at 100%. Now use 43% of this amount as coming through the radiator. This leave 57% recirculating within the box, because the Equi-Temp draws it in at the ceiling line. Pfening air changes equal more than 100 times per hour.